

Building Manager: [John Cochran, john.cochran@oregonstate.edu](mailto:john.cochran@oregonstate.edu)  
 Assessment Date: 3/15/2022  
 Assessment Number: **10558**  
 Location: Johnson Hall Entire  
 Reinspection date:

A joint fire safety inspection of the facility listed above was performed by the Environmental Health & Safety - Fire and Life Safety and the Corvallis Fire Department. These fire safety deficiencies could result in a fire or jeopardize the safety of those occupying the facility. Please see that these items are corrected immediately and no later than the scheduled reinspection date noted with this report. If you have any questions regarding this inspection, please email Brian Lilley (EH&S - Fire and Life Safety) at [brian.lilley@oregonstate.edu](mailto:brian.lilley@oregonstate.edu).

**Note: Deficiencies that are bold and underlined remain uncorrected from the last fire/life safety inspection(s) and should be corrected immediately.**

\* Annotates a deficiency identified by the Corvallis Fire Department.

Indicated on the report are items which should be corrected by the Departments (DEPT) that occupy this building, Facilities Services (FS), Environmental Health & Safety (EHS), and Recycling (RECY). Please forward a copy of this report to the responsible group(s) and begin corrective action so that all deficiencies have been corrected prior to the reinspection date. If assistance is required from Facilities Services to estimate or correct an item assigned to a Department, contact the Work Coordination Center at ext. 7-2969.

**Facilities Services Priority Codes:**

**Priority 1:** items are considered immediate safety hazards and should be corrected within 48 hours of notification if possible. If repairs cannot be made immediately, temporary measures may be taken.

**Priority 2:** items should be corrected within the five-week period before the scheduled reinspections.

**Priority 3:** items are long term fixes that should be either added to an ongoing work list or to the capital improvement list for campus upgrades.

**Comments:**

<b>Priority code</b>	<b>Standard in need of attention</b>	<b>Reg.Reference</b>	<b>Location</b>	<b>Resp</b>	<b>Observations &amp; Recommendations</b>	<b><a href="#">Date Corrected</a></b>
2	Power strips, extension cords, or any other electrical cord shall not extend through walls, ceilings, floors, under doors or floor coverings, or be subject to damage.	2019 OFC 604.5	Bench 200Z:Hood 203	DEPT DEPT DEPT	Remount hanging power strip according to manufacturer's instructions.	
2	Power strips, extension cords, or any other electrical cord shall not extend through walls, ceilings, floors, under doors or floor coverings, or be subject to damage.	2019 OFC 604.5	Bench 200x:floor	DEPT DEPT DEPT	Provide ground protection (cord protector) for gas line tubing and/or wiring.	
2	Power strips, extension cords, or any other electrical cord shall not extend through walls, ceilings, floors, under doors or floor coverings, or be subject to damage.	2019 OFC 604.5	Bench 206x:floor	DEPT DEPT DEPT	Provide ground protection (cord protector) for gas line tubing and/or wiring.	

**Priority  
code**

**Standard in need of attention**


Reg.Reference

Location

Resp

Observations & Recommendations

[Date Corrected](#)

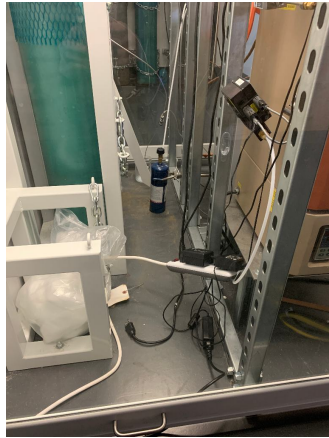

Hood 203 Bench 200z